

CITY OF ANAHEIM ELECTRICAL NOTE

THERE ARE EXISTING 69KV, 12KV AND STREETLIGHT OVERHEAD AND UNDERGROUND ELECTRICAL FACILITIES WITHIN THE PROJECT'S BOUNDARY. PLEASE PROTECT ALL ABOVEGROUND AND UNDERGROUND ELECTRICAL FACILITIES IN PLACE, AND CONTACT UTILITY INSPECTOR JEFF ROBISON AT 714-292-8881 PRIOR TO WORKING WITHIN PROXIMITY TO ENERGIZE ELECTRICAL FACILITIES.


ANY ADJUSTMENTS OF ELECTRICAL PULLBOXES AND VAULTS TO FINAL GRADE, PLEASE COORDINATE WITH UTILITY INSPECTOR AT LEAST 48 HOURS PRIOR TO THE PLANNED WORK. MAINTAIN ALL CLEARANCES PER GENERAL ORDER 95 AND 128. ANY PROPOSED ELECTRICAL PULLBOXES/VAULTS/POLES REQUIRING RELOCATION REQUIRED, PLEASE CONTACT VINH TRAN AT 714-765-4273.

LEGEND

- 2" COLD MILL AND 2" AC OVERLAY
- 4" AC INCLUDES 2" AC SURFACE COURSE
- 7" AC INCLUDES 2" AC SURFACE COURSE OVER 14" CLASS II AB

DISPOSITION NOTE

- 1 PROTECT IN PLACE

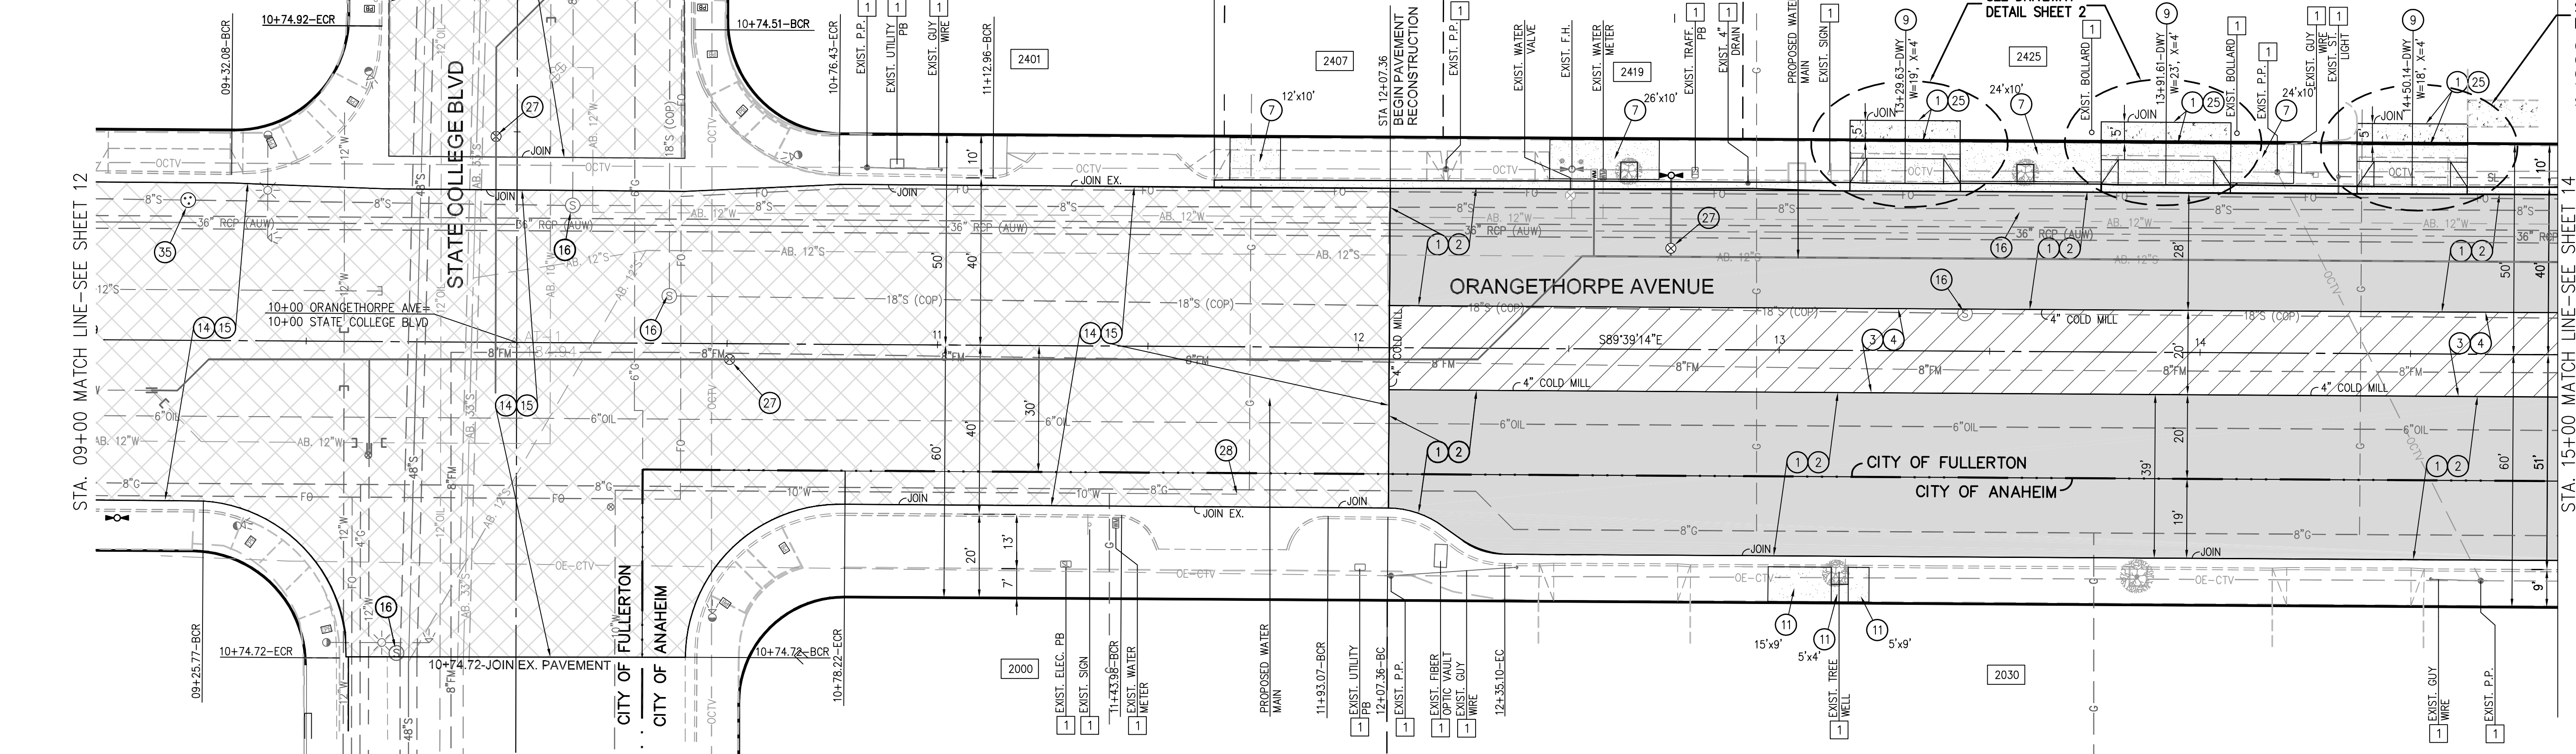

CONSTRUCTION NOTES

- EXCAVATE FOR PROPOSED STRUCTURAL SECTION AND IMPROVEMENTS.
- CONSTRUCT 7" AC, INCLUDED 2" THICK ARHM SURFACE COURSE OVER 14" CLASS II AB.
- COLD MILL 4" THICK EXISTING AC PAVEMENT.
- CONSTRUCT 4" AC, INCLUDES 2" THICK ARHM SURFACE COURSE.
- REMOVE AND RECONSTRUCT CURB & GUTTER PER CITY OF FULLERTON STD PLAN NO. 120, TYPE A. (VARIABLE CF) TO MATCH EXIST. TOP OF CURB.
- REMOVE EXIST. IMPROVEMENTS AND RECONSTRUCT CONC. SIDEWALK PER CITY OF FULLERTON STD PLAN NO. 122.
- REMOVE AND RECONSTRUCT DRIVEWAY APPROACH (COMMERCIAL) PER CITY OF FULLERTON STD PLAN 121-2. CONCRETE TO BE HIGH EARLY STRENGTH CONCRETE MIX W/COMP. STRENGTH OF 3000 PSI IN 24 HOURS.

- REMOVE EXIST. IMPROVEMENTS AND RECONSTRUCT SIDEWALK PER CITY OF ANAHEIM STD PLAN 110-B.
- COLD MILL 2" THICK EXISTING AC PAVEMENT.
- CONSTRUCT 2" THICK ARHM OVERLAY.
- ADJUST EXIST. MANHOLE TO GRADE PER CITY OF FULLERTON STD PLAN 204.
- CONSTRUCT 6" PCC OVER NATIVE. CONCRETE TO BE HIGH EARLY STRENGTH CONCRETE MIX W/COMP. STRENGTH OF 3000 PSI IN 24 HOURS.
- ADJUST EXIST. WATER VALVE TO GRADE.
- CUT AND PLUG EXIST. 10" WATER MAIN.
- CONSTRUCT SEWER MANHOLE PER CITY OF FULLERTON STD PLAN 201.

