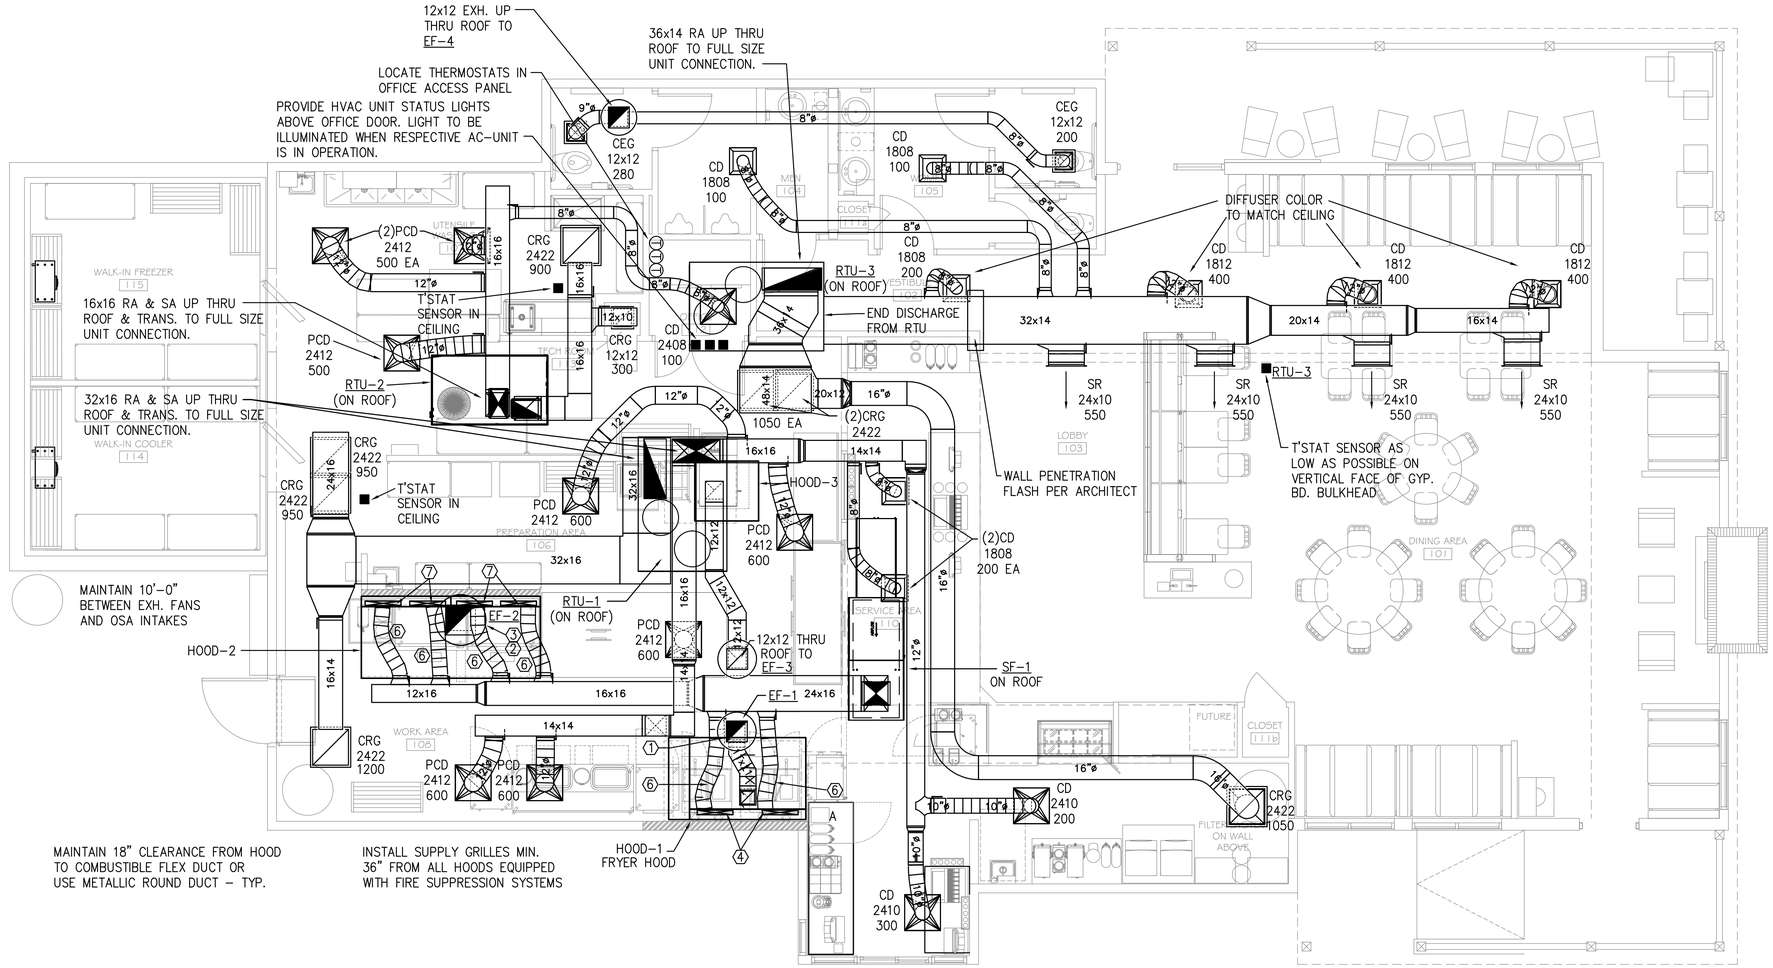

NOTE:

1. 11x11 GREASE DUCT FROM HOOD TO EF-1 ON ROOF, 1333 CFM.
2. 14x14 GREASE DUCT TO 14x14 HOOD CONNECTION
3. 14x14 GREASE DUCT TO EF-2 ON ROOF, 2050 CFM
4. 12"ø RUNOUT TO BACK SUPPLY PLENUM, 533 CFM, TYP OF 2
5. 24x16 MUA DUCT THRU ROOF TO SF-1, 2706 CFM
6. ALL FLEX DUCT TO BE SUPPORTED AT NOT GREATER THAN 4' INTERVALS MAINTAIN 18" CLEAR FROM HOOD OR USE SHEET METAL DUCT
7. 12"ø RUNOUT TO BACK SUPPLY PLENUM, 410 CFM, TYP OF 4

CONSTRUCTION FLOOR PLAN - HVAC
1/4" = 1'-0"

RODNEY L. SARTAIN - ARCHITECT
1909 COURTNEY DR. HOMEWOOD, ALABAMA 35209
OFFICE: (205) 879-5458
FAX: (205) 879-5460
EMAIL: rls@rlsdesigngroup.com

No.	Description	Date

FLOOR PLAN - HVAC

M2.1

Jack's Family Restaurants
Southern Charm (SC-68)
OLIVE BRANCH, MISSISSIPPI

12-10-20
20-2639

JAY R. EIRING
REGISTERED PROFESSIONAL ENGINEER
27005
STATE OF MISSISSIPPI

November 30, 2020

Jay R. Eiring
Engineer
802 Mountain Lake Ct
Prattville, AL 36067
PH:205-213-8875

PROJECT #20-015

PERMIT ISSUE

Z:\Rodney Sartain\20-3.16 Jacks - Olive Branch MS\20-3.16 MECH.dwg - emn